

RP2(Y) Pressure switches intrinsically safe

All industrial environments

Reduced overall dimensions

Good vibration resistance

Resistant to short duration overpressure

LCIE 03 ATEX 6160X

CE 0081

 I M 1
EEx ia I

 II 1 G and D
EEx ia IIC T6 or T5

 II 2 D

Hazardous areas : 0, 1, 2, 20, 21, 22

These pressure switches maintain a constant pressure around a chosen set value: regulator action. They trigger an alarm or safety system, when the pressure reaches a critical pre-set value.

Important

Normal operation must be between 10% and 90% of the selected scale. The deadband values in the table overleaf are defined under these conditions.

All circuits must be equipped with a safety system protecting them against excess pressure.

Any pulsating circuit must be fitted with pulsation dampeners. Suitable separators must be used with incompatible process fluids.



Technical Data (20°C)

Fluids	All fluids compatible with the measuring element from -40...150°C
Operating ambient temperature	From -30...70°C
Storage temperature	From -40...70°C
Reproducibility	±2% of F.S.
Minimum deadband	Depending on the type of microswitch used (see table overleaf)
Conform to CE	Low Voltage Directive DBT 73/23/CE Directive ATEX 94/9/CE (EN50014, EN50020, EN50281-1-1)
Degree of protection	IP 65, NF EN 60529
Weight	0.960 kg

Manufacturing

Housing	Plastic PA6, blue
Body	ZAMAK plated black
Wall mounting	2 CL M5 screws
Earth connection	Via internal terminal block
Electrical connection	Via internal terminal block with P.E. 9 for cables 5.5 to 8.5 mm dia
Graduated scale	Internal calibrated scale
Pressure connection	G 1/2
Measuring element	1.4404 s.s. (316L) diaphragm

**BOURDON
HAENNI**

made to measure




Adjustable ranges

Scale	Code	Max. P		MAXI FIXED DEADBAND			
		Permanent	Accidental	Gold contact	Tropicalized	Fixed Low Deadband, Gold contact	
				M at 10 % of scale	N at 90 % of scale	S at 10 % of scale	S at 90 % of scale
		bar	bar	mbar	mbar	mbar	mbar
0 + 1	41	10	50	120	330	70	120
0 + 1.6	42			150	390	80	140
0 + 2.5	43			180	480	90	160
0 + 4	44			210	540	100	180
0 + 6	45			240	630	115	200
0 + 10	46			300	750	125	200
0 + 4	51	40	100	600	1320	250	400
0 + 6	52			750	1620	250	470
0 + 10	53			840	2010	275	540
0 + 16	54			960	2370	300	610
0 + 25	55			1050	2730	320	630
0 + 40	56			1140	3150	345	760
0 + 10	61	100	200	1500	3600	460	1000
0 + 16	62			2100	3960	640	1400
0 + 25	63			2700	5550	820	1800
0 + 40	64			3300	7350	1010	2200
0 + 60	65			3900	9600	1200	2600
0 + 100	66			4500	13200	1380	3000

Cable identification, current rating

Cable identification




Current rating

Microswitch type SPDT

M	Gold Contact Fixed deadband	10 mA min.; 50 mA max. 28 Vdc max.
N	Tropicalized Fixed deadband	0.1 A min.; 0,12 A max. 28 Vdc max.
S	Fixed Low Deadband, Gold contact Fixed deadband	10 mA min.; 50 mA max. 28 Vdc max.

Operating principle

A flexible diaphragm actuates a microswitch by means of a piston. The set point is adjusted by means of a compressible spring installed in opposition.

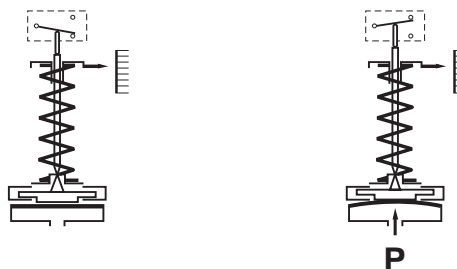

Regulation

Pressure of regulator type RP2(Y)

LCIE 03 ATEX 6160X

CE 0081



I M 1
EEx ia I



II 1 G and D
EEx ia IIC T6 or T5



II 2 D Use without safety barrier certified for zone 21 or 22


Dust IP6X	Gases
T° surface	Class
60°C	ambient T° -30... 55°C (T6)
75°C	ambient T° -30...70°C (T5)

The installation must be in accordance to U_{max} and I_{max}

All necessary measures must be taken by the user, to avoid the calorific transfer from the fluid to the apparatus head increasing the head's temperature to such that it reaches the self-ignition temperature of the gas in which it is used.

Installation instructions

Hazardous area
Area 0, 1, 2, 20, 21, 22



Certified safety barrier

Non hazardous area



$$U_{max} = 28 \text{ Vdc}$$

$$I_{max} = 120 \text{ mA}$$

$$P = 0.8 \text{ W}$$



$$C_a > C_i + C_{cable}; L_a > L_i + L_{cable}$$

$$C_i = \text{Negligible}; L_i = \text{Negligible}$$

Don't forget the barrier's resistors in the determination of Rc1.

In area 0 or 20, the loop calculation of the association pressure switches with safety barrier must be approved by notified organism.

Dimensions (mm)

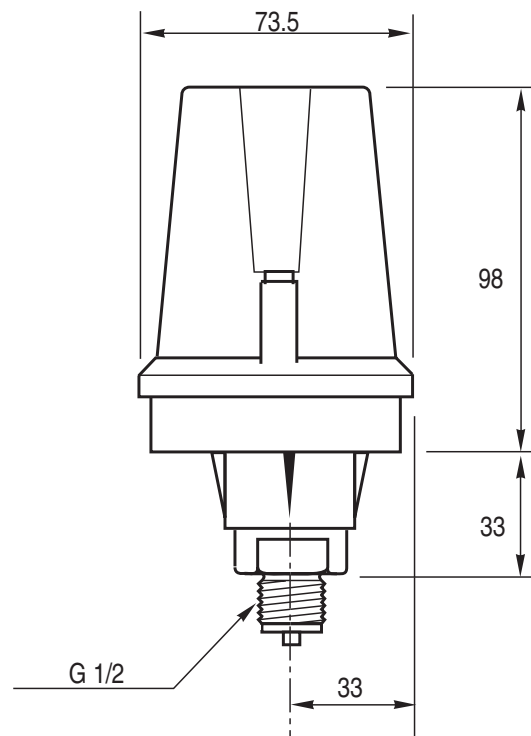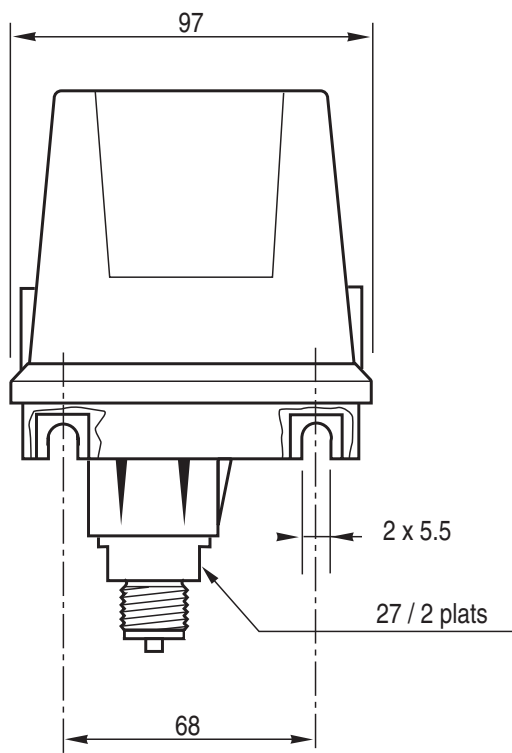

Options

Cleanliness for oxygen service **Code 0765**
 Stainless steel tag plate and wire **Code 9941**
 Connection on pipe 2 " dia. **Code 0407**
 Adjustment of the set point **Code SETP**

Ordering Details - RP2(Y)

		RP2Yxxxx			
Model	1' digit	R			
Pressure switch					
Type	2'...3' digit	P2			
P2					
Type of protection	4' digit	Y			
Intrinsically safe					
Type of microswitch	5' digit	M			
1 gold contact changeover switch		N			
1 tropicalized changeover switch		S			
1 gold contact changeover switch, fixed low deadband					
Hydraulic connection	6' digit	3			
G 1/2 male (standard version)		6			
1/2 NPT male		8			
1/4 NPT female		N			
1/2 NPT female					
Pressure range	7'...8' digit	xx			
See codes in table					

code	range in bar		
41	0	+	1
42	0	+	1.6
43	0	+	2.5
44	0	+	4
45	0	+	6
46	0	+	10
51	0	+	4
52	0	+	6
53	0	+	10
54	0	+	16
55	0	+	25
56	0	+	40
61	0	+	10
62	0	+	16
63	0	+	25
64	0	+	40
65	0	+	60
66	0	+	100

UK/06-2005 This data sheet may only be reproduced in full.